

# EPMG-1270 & EPMG-2470

## ***Generator Excitation Booster System User Manual***



For use with brushless self-excited, excitation systems with continuous excitation current below 8A and intermittent excitation 15A up to 10 seconds.



**KUTAI ELECTRONICS INDUSTRY CO., LTD.**

TEL : +886-7-8121771

FAX : +886-7-8121775

Website : [www.kutai.com.tw](http://www.kutai.com.tw)

Headquarters : No.3, Lane 201, Chien Fu St., Chyan Jenn Dist., Kaohsiung 80664, TAIWAN



## SECTION 1 : INTRODUCTION

The EPMG-1270 / 2470 converts DC battery power into an auxiliary excitation power source. In series with brushless self-excited (shunt), excitation systems increasing generator excitation power. As shown in the drawing below, the voltage regulator excitation output in series with the EPMG-1270 / 2470 output provides the generator excitation power.

EPMG-1270 / 2470 increases generator transient load handling capacity and improves recovery time from voltage dips when a load is added, without affecting the ability of the voltage regulator to maintain voltage stability with the same effect as PMG systems. When used gensets with no load excitation voltage of 15 – 50 Vdc the benefits are particularly significant.

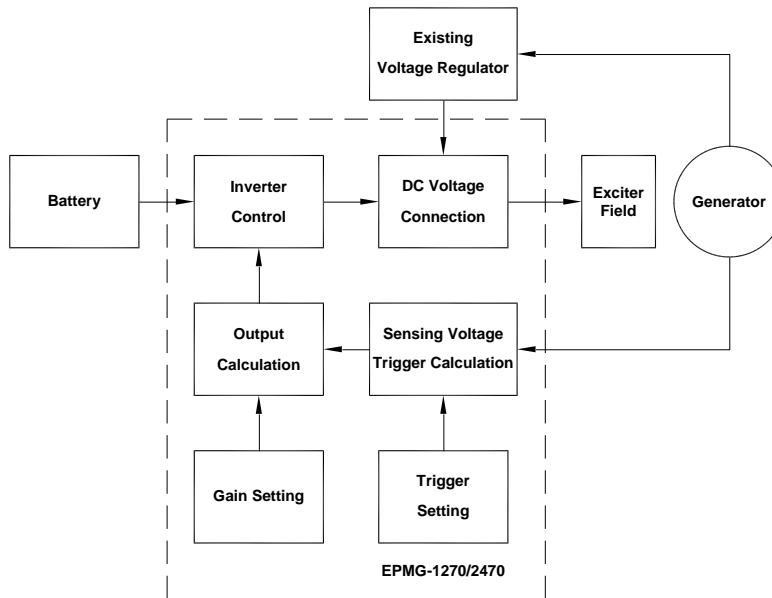


Figure 1 EPMG-1270 / 2470 Flow Chart

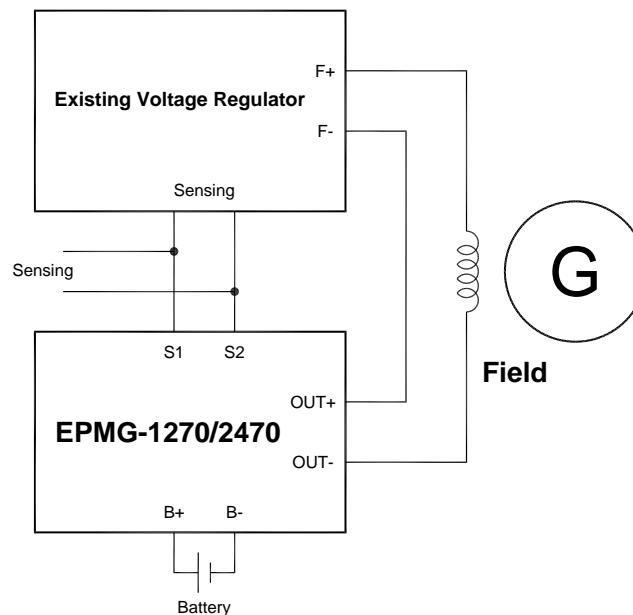


Figure 2 EPMG-1270 / 2470 + Self-excited (shunt) excitation system

### ATTENTION

Incorrect connection of EPMG® output polarity will cause excitation failure.

## SECTION 2 : SPECIFICATION

### Sensing Input (S1, S2)

Voltage	80 – 600 Vac (Single phase)
Frequency	50/60 Hz

### Power Output (OUT-, OUT+)

Voltage	90 Vdc
Power	Max. 400 VA

### Battery Power Input (B-, B+)

Voltage	EPMG-1270 8 – 18 Vdc / 50A EPMG-2470 16 – 36 Vdc / 25A
Protections	Battery Reverse Polarity Battery Current Limit
Fuse spec.	EPMG-1270 (60A) / EPMG-2470 (30A)

### Applicable AVR

Max. Excitation Current 8A

### Typical System Response

10 ms

### Static Power Dissipation

Less than 0.5 watts

### Efficiency

greater than 85% @ Full load

### Environment

Operating Temperature	-40 to +70 °C
Storage Temperature	-40 to +85 °C
Relative Humidity	Max. 95%
Vibration	5.5 Gs @ 60 Hz

### Dimensions

175.0 (L) x 115.0 (W) x 104.0 (H) mm  
6.89 (L) x 4.53 (W) x 4.09 (H) inch

### Weight

2.90 kg +/- 2%  
6.39 lb +/- 2%

## SECTION 3 : OUTLINE / DIMENSIONS

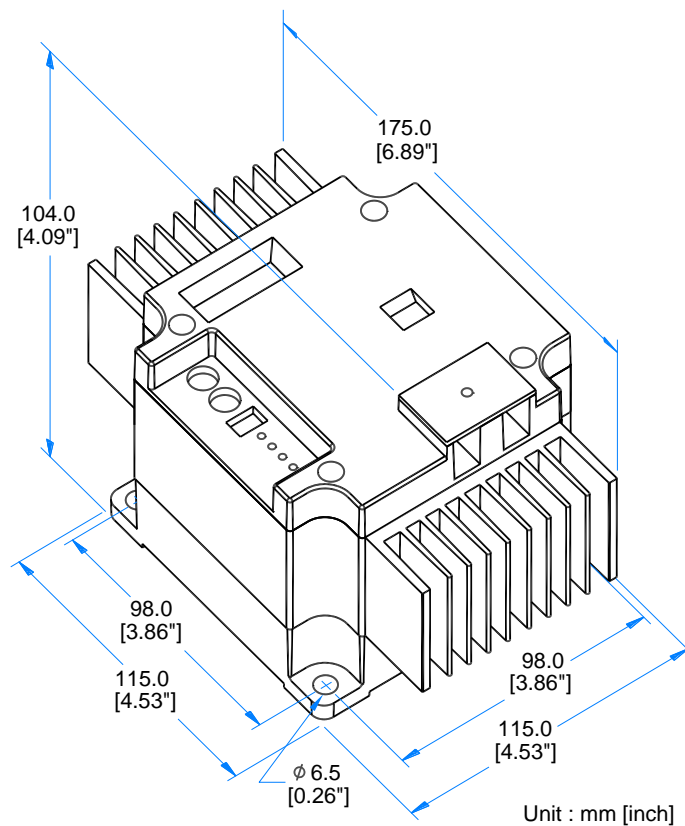


Figure 3 Dimension Drawing

### Accessories :

1. Connection wires ( White x 2, Brown x 2 )
2. Screw bolt M6L20 x 4

## SECTION 4 : FUNCTIONAL DESCRIPTION

### Trigger Activation Setting

Settings 0 – 9 ( 3 – 16.5 %, See Table 1).  
Voltage drop 3 – 16.5 %, adjustable

### Output Gain

Settings 0 – 9 (40 – 400, See Table 1).  
Output (V) = Gain x (Droop voltage / Rated voltage)  
At this time generator field voltage = voltage regulator excitation + EPMG® output voltage.

### Output Test

1. Disconnect OUT- and OUT+ wiring before testing.
2. Set DIP-SW1 to ON position. 90 Vdc output will appear across OUT- and OUT+ for 5 seconds.
3. TEST LED stays illuminated indicates unit has passed. Flashing of the LED indicates a malfunction.
4. When test is complete place DIP-SW1 in OFF position and reconnect wiring to OUT- and OUT+.

Note 1 : Do not contact OUT- or OUT+ terminals during test !!

Note 2 : Test can only be carried out with S1, S2 frequency below 40 Hz.

### Output LED (Green)

Output indicator


### Ready LED (Green)

Flashing : Standby  
Steady : Sensing input is stable, unit is ready to output

### Batt-Volt LED (Red) Battery Voltage Malfunction Indicator

Rated Voltage Range EPMG-1270 : 8 – 18 Vdc  
EPMG-2470 : 16 – 36 Vdc

When battery voltage is abnormal, the unit will not operate.

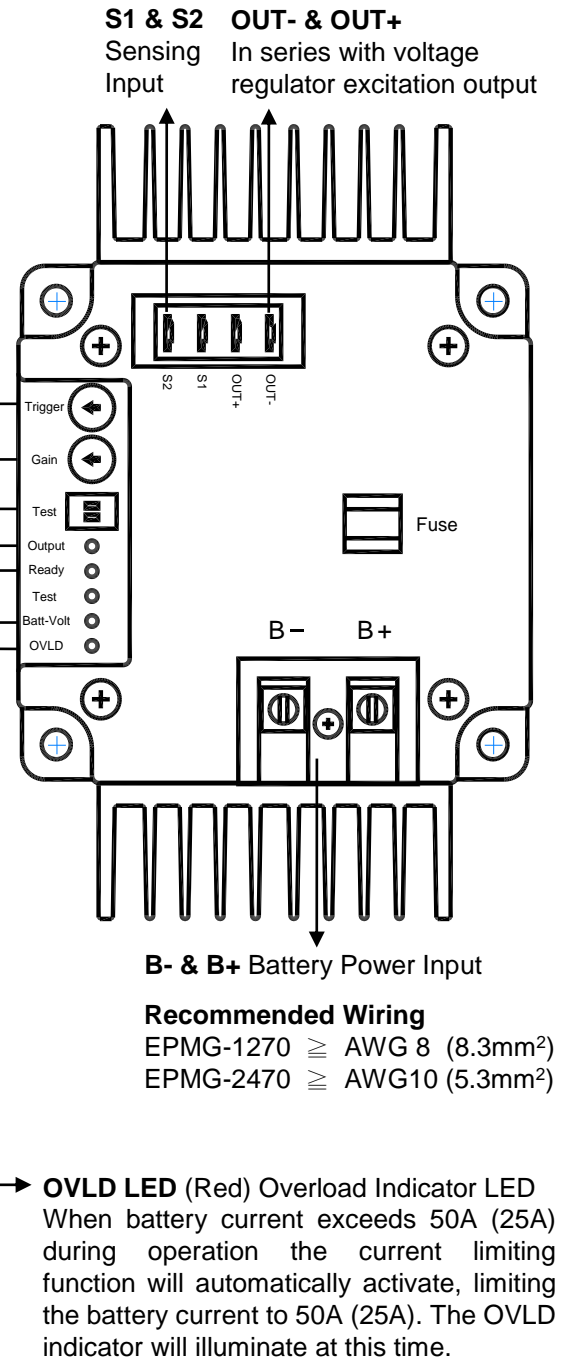

Setting Item	0	1	2	3	4	5	6	7	8	9
Trigger	3.0%	4.5%	6.0%	7.5%	9.0%	10.5%	12.0%	13.5%	15.0%	16.5%
Gain	40	80	120	160	200	240	280	320	360	400

Table 1

## SECTION 5 : EPMG<sup>®</sup> ACTIVATION TIMING AND OUTPUT SETTING

If the voltage drops to the level of the Trigger setting when a load is added to a generator the EPMG<sup>®</sup> will activate output. The magnitude of the output is determined by the Gain setting (40 – 400 see Table 1) and magnitude of the voltage drop. As the sensing voltage recovers the output will slowly turn off. Ex. Gain = 160, voltage drop 10%, EPMG<sup>®</sup> output =  $160 \times 10\% = 16V$ . See Figure 4 below for EPMG<sup>®</sup> Activation timing.

### Trigger Setting (Activation Timing) :

The lower the Trigger setting the more frequently the EPMG<sup>®</sup> will activate and consume more battery power.

### Gain Setting Procedures :

It is recommended to adjust GAIN from a lower setting to higher settings to find the optimal excitation response curve. If the Gain is set too low the effect of the additional excitation power will not be obvious. If the Gain is set too high it could lead to large fluctuations in generator voltage. For optimal setting please see Section 6.

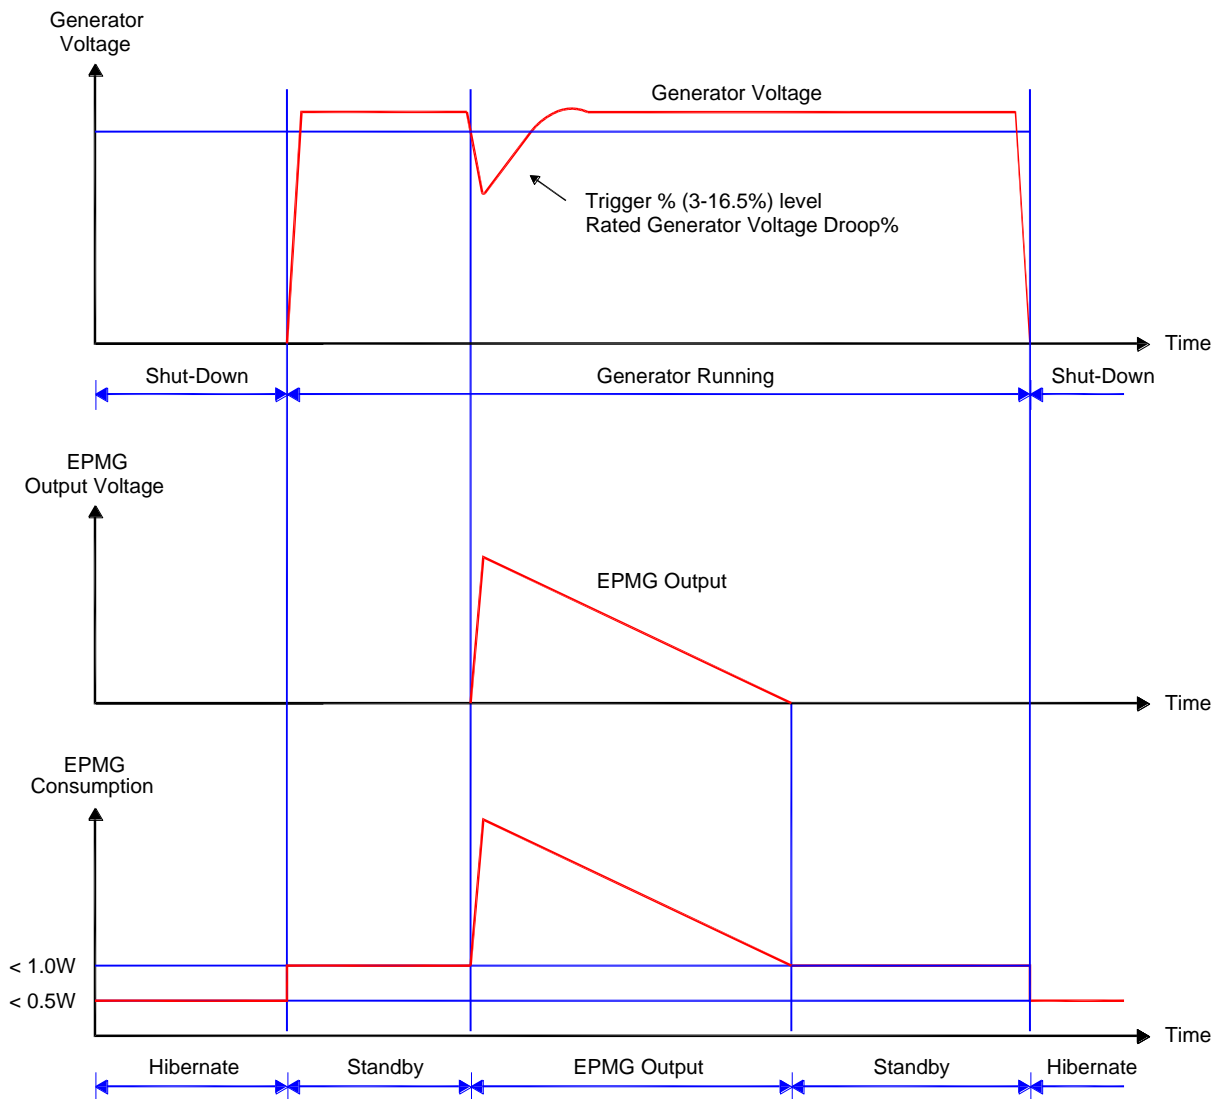


Figure 4 Activation Timing For Auxiliary Excitation Power

When the EPMG<sup>®</sup> is installed on some generators the frequency (engine speed) may temporarily drop below the generator Under Frequency protection point when a heavy load is added. This will cause an extremely large voltage drop because of the reduction of excitation caused by the Under Frequency protection function. As generator voltage drops output power will follow it downward until engine horsepower and generator output power are balanced. As engine speed (generator frequency) gradually recovers, generator voltage will also follow it in returning to normal.

## SECTION 6 : OPTIMAL RESPONSE SETTING

Install the EPMG-1270 / 2470 in series with the voltage regulator and with generator operating with load adjust the Gain from low to high to find the optimal excitation response curve, as shown in the curve in Figure 5 (Voltage Regulator + EPMG®).

That figure includes three different curves: Gain setting Too Low, Ideal and Too High.

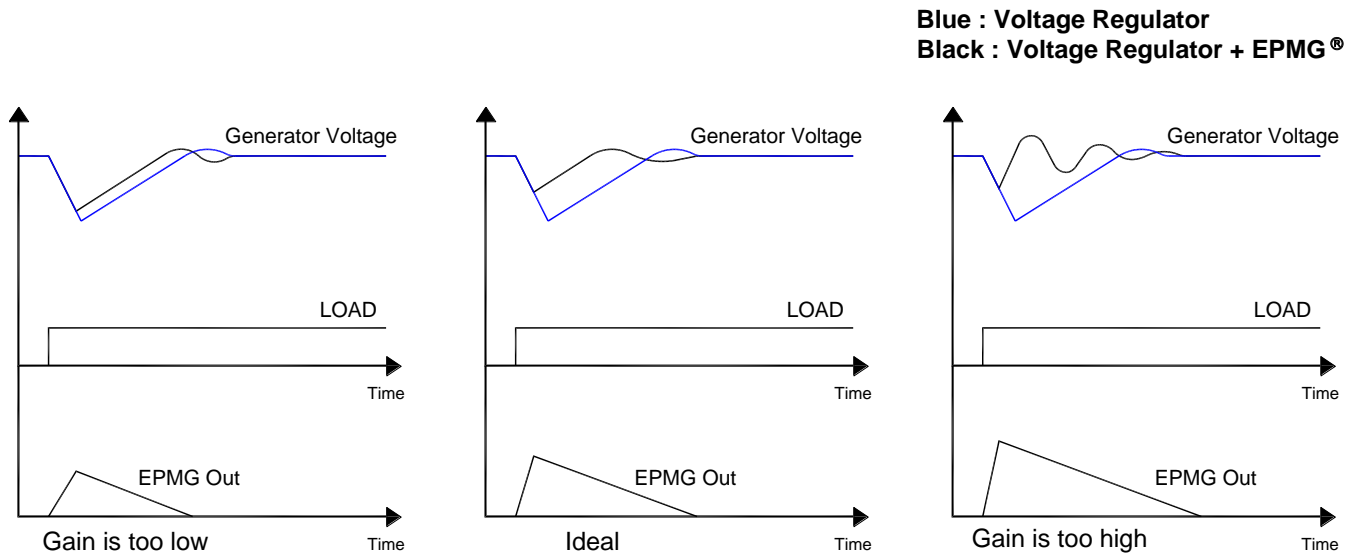


Figure 5 AVR + EPMG® Response Curves For Different Gain Settings

### ATTENTION

**All AC voltages are average.**

- ※ Use only the replacement fuses specified in this user manual.
- ※ Appearance and specifications of products are subject to change for improvement without prior notice.